

245 KV CURRENT TRANSFORMER TYPE: IMB 245

CLIENT:
(AS APPLICABLE)

END CUSTOMER:
APTRANSCO

W.O. NO.:
(AS APPLICABLE)

PROJECT:
(AS APPLICABLE)

P.O. NO.:
(AS APPLICABLE)

QTY.:
(AS APPLICABLE)

CT RATIO:
500-300/1-1-1-1-1

Drawing approval subject to valid vendor registration

NOTE : DRAWING APPROVAL SUBJECT TO VALID TYPE TEST REPORTS, TO BE CHECKED DURING ACCEPTANCE TESTS.

Chief Engineer/Construction

SR. NO.	REFERENCE OF STD DRGS/ DOCUMENTS	REV.	DESCRIPTION
1.	1HYT903320-030	A	GENERAL ARRANGEMENT
2.	1HYT903320-031	C	RATING PLATE
3.	1HYT903320-032	B	SECONDARY TERMINAL BOX
4.	1HYT903320-033	C	MAGNETIZATION CURVE

We reserve all rights in this document and in the information contained there in. Reproduction, use or disclosure to third parties without express authority is strictly forbidden ©ABB.

Ⓐ New drg. prepared.

Ⓑ Change in sr no. 2,3,4

Ⓒ Change in sr no. 2,4

This drawing is a COMPUTER ORIGINAL and does not require signature for its authentication

Prepared: SR	Checked: PDS	Approved: SN
Without Sep. PL.: <input type="checkbox"/>	Same PL. Same No.: <input type="checkbox"/>	Sep. PL. Other No.: <input type="checkbox"/>
Derived by:	Supersedes:	Supersedes by:
A 2021-01-12		
B 2021-01-29		
C 2021-02-04		



LIST OF DOCUMENTS FOR IMB 145 TYPE CT

1HYT903320-029




Scale NTS

T.Sh. 1

Sheets 1

This document is COMPUTER ORIGINAL and does not need signature for its authentication

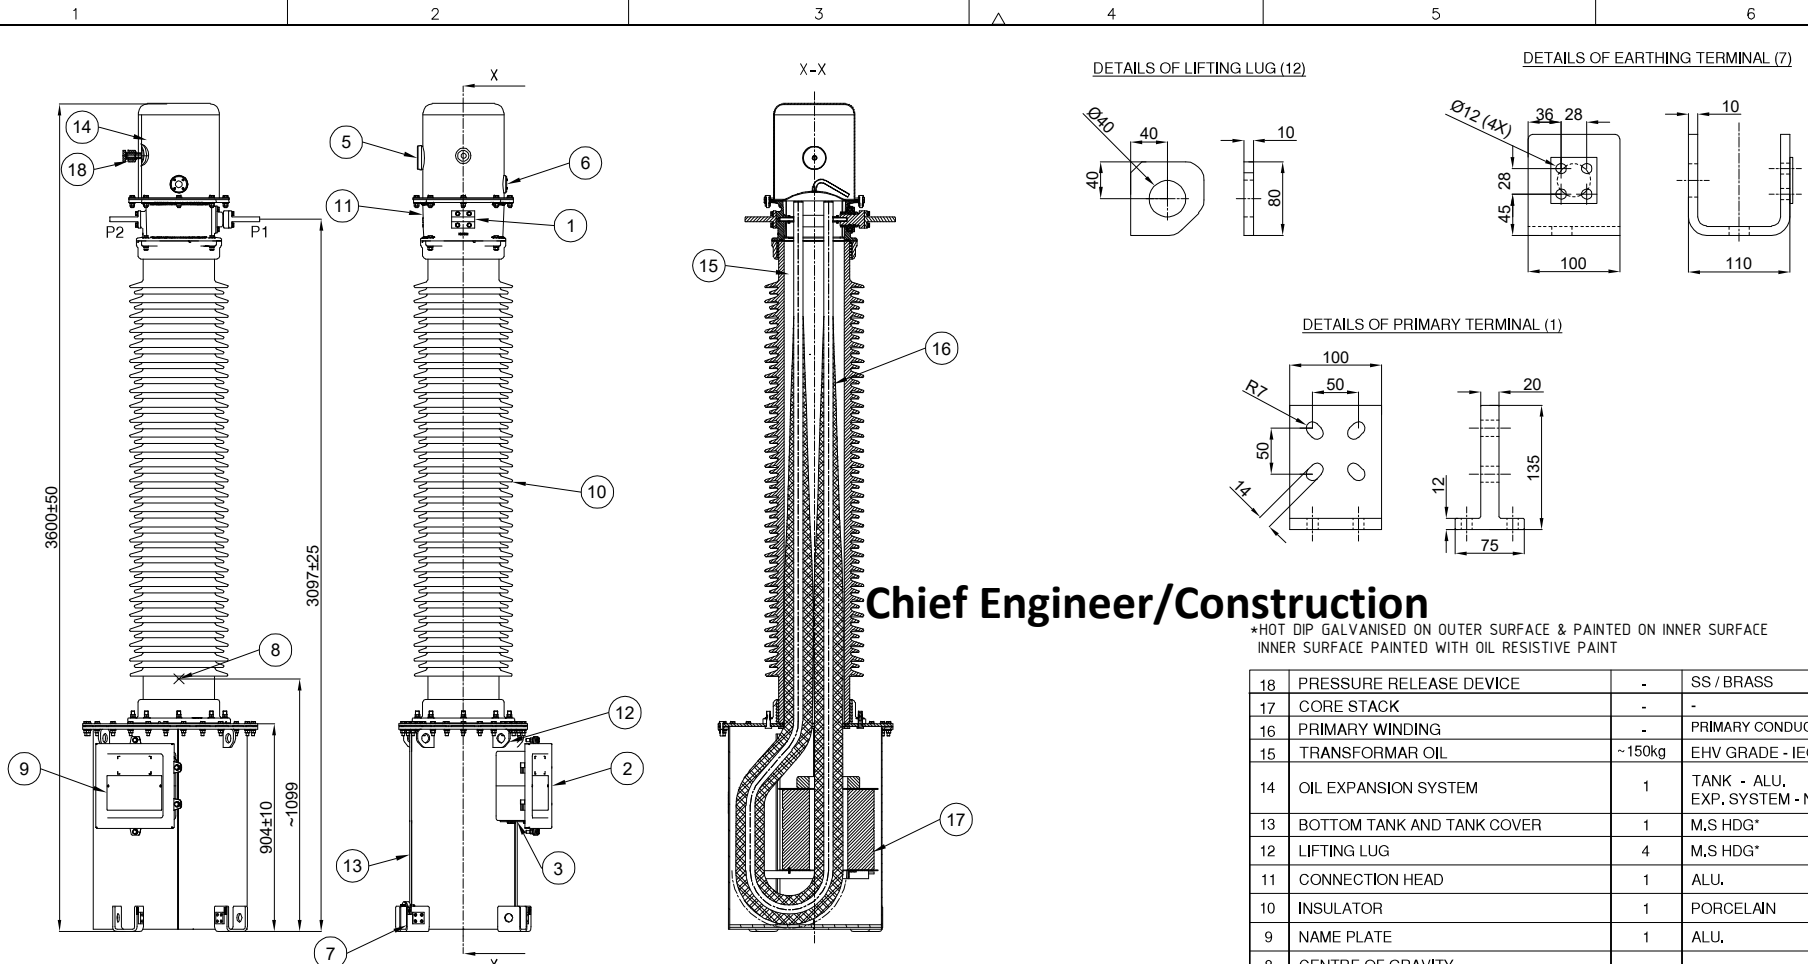

Chief Engineer/Construction

*HOT DIP GALVANISED ON OUTER SURFACE & PAINTED ON INNER SURFACE
 INNER SURFACE PAINTED WITH OIL RESISTIVE PAINT

18	PRESSURE RELEASE DEVICE	-	SS / BRASS
17	CORE STACK	-	-
16	PRIMARY WINDING	-	PRIMARY CONDUCTOR (ALU)
15	TRANSFORMER OIL	~ 150kg	EHV GRADE - IEC:60296
14	OIL EXPANSION SYSTEM	1	TANK - ALU, EXP. SYSTEM - N2 GAS,
13	BOTTOM TANK AND TANK COVER	1	M,S HDG*
12	LIFTING LUG	4	M,S HDG*
11	CONNECTION HEAD	1	ALU.
10	INSULATOR	1	PORCELAIN
9	NAME PLATE	1	ALU.
8	CENTRE OF GRAVITY	-	-
7	EARTH CLAMP	4	S.S. WELDED OVER M.S.
6	OIL LEVEL INDICATOR	1	TOUGHENED GLASS
5	OIL FILLING COVER	1	ALU.
4	OIL DRAIN PLUG WITH BLANKING PLATE	1	M,S HDG*
3	REMOVABLE UNDRILLED GLAND PLATE	1	M,S HDG*
2	SECONDARY TERMINAL BOX	1	M,S HDG*
1	PRIMARY TERMINAL	2	ALU.
Sr. No.	Item Description	Qty.	Material

- NOTES:**
- 1) DEVIATION FOR DIMENSIONS WITHOUT SPECIFIED TOLERANCES AS PER IS: 2102 - (EXTRA COARSE).
 - 2) ALL NUTS, BOLTS AND WASHERS ARE OF STAINLESS STEEL/ MS HOT DIP GALVANIZED
 - 3) ALL DIMENSIONS ARE IN mm.
 - 4) TOTAL WEIGHT 1150 kg approx.
 - 5) CREEPAGE DISTANCE 6125 mm.
 - 6) ALL FERROUS PARTS EXPOSED TO ATMOSPHERE ARE HOT DIP GALVANIZED.
 - 7) GENERAL TOLERANCE AS PER IS:2768-C

NOTE : DRAWING APPROVAL SUBJECT TO VALID TYPE TEST REPORTS, TO BE CHECKED DURING


Revision Details:
 (A) New drg. prepared.

We reserve all rights in this document and in the information contained therein. Reproduction, use or disclosure to third parties without express authority is strictly forbidden. © ABB

Revision	ACCEPTANCE TESTS.	245 kV OUTDOOR CURRENT TRANSFORMER TYPE IMB 245	GENERAL ARRANGEMENT DRAWING (Medium Tank)	Prepared: SR	Checked: SNP	Approved: SN	file: 3320-030	Total Sh. 1
A	2021-01-12			ABB APPSIL			1HYT903320-030	Sh.No. 1

Drawing approval subject to valid vendor registration

ABB Current transformer		APPSIL	Production year - YYYY	Made in India	
Serial number	nnnnnn	Type	IMB 245	Frequency	50 Hz
Insulation level	245/460/1050	Standard	IEC: 61869-1,2	Temperature range	-5 to +50 °C
Rated pri. normal current	500A	Total mass(Approx)	1150 kg	Total creepage minimum	6125mm
Max continous primary current	600A	Insulation oil(Approx)	150 kg	lth	40/1 kA/s
GA Drawing	1HYT903320-030	Suitable for Hot line washing	Yes	ldyn	100 kAp

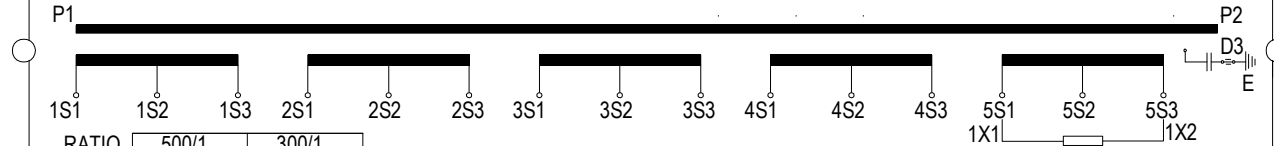

RATIO	500/1	300/1
CORE-1	1S1-1S3	1S1-1S2
CORE-2	2S1-2S3	2S1-2S2
CORE-3	3S1-3S3	3S1-3S2
CORE-4	4S1-4S3	4S1-4S2
CORE-5	5S1-5S3	5S1-5S2

AUX. REACTOR CONNECTION DETAIL FOR CORE 5 ONLY
 1.CONNECT SHORTING LINK BETWEEN 1X1-5S1 & 1X2-5S3 FOR THE RATIO OF 500/1 RESPECTIVELY. TAKE OUTPUT FROM 1X1-1X2.
 2.DO NOT CONNECT SHORTING LINK FOR THE RATIO OF 300/1.

CORE	CORE-1	CORE-2	CORE-3	CORE-4	CORE-5
I A	500-300/1	500-300/1	500-300/1	500-300/1	500-300/1
Vk V/B VA	20	>40(Rct+10)/300	>80(Rct+5)/350	>80(Rct+5)/350	20
CI	5P	PX	PX	PX	0.2S
ISF/ALF	20	-	-	-	<5
Io mA	-	<30 at Vk @500/1	<30 at Vk @500/1	<30 at Vk @500/1	-
Rct Ω	-	<5/3	<5/3	<5/3	-

END CUSTOMER: APTRANSCO
 ABB WORKS ORDER NO: (AS APPLICABLE)
 PROJECT: (AS APPLICABLE)

Caution 1)Ensure D3(Tan Delta) Bushing connection with Earth
 2)Secondary terminals must be short circuited before burden is disconnected

Serial number nnnnnn to be decided when manufactured
 Production year yyyy = Actual year,date & month of Production
 Material: Aluminium 2mm Thk.
 Letter height 3 mm

NOTE : DRAWING APPROVAL SUBJECT TO VALID TYPE TEST REPORTS, TO BE CHECKED DURING ACCEPTANCE TESTS.

Chief Engineer/Construction

Revision		245 kV OUTDOOR CURRENT TRANSFORMER TYPE IMB 245	RATING PLATE	Prepared: SR	Checked: PDS	Approved: SN	File: 3320-031	Total sh. 1
A	2021-01-12			ABB APPSIL			1HYT903320-031	Sh.No. 1
B	2021-01-29							1

This drawing is a COMPUTER ORIGINAL and does not require signatures for it's authentication

Revision Details:
 Ⓞ Spec for core-2,3,4 revised

Revision Details:
 Ⓞ Typo error in aux. reactor note corrected, specification revised



Revision Details:
 Ⓞ New drg prepared.

We reserve all rights in this document and in the information contained there in.Reproduction, use or disclosure to third parties without express authority is strictly forbidden. © ABB.




NOTE : DRAWING APPROVAL SUBJECT TO VALID TYPE TEST REPORTS, TO BE CHECKED DURING ACCEPTANCE TESTS.

Section-AA

Drawing approval subject to valid vendor registration

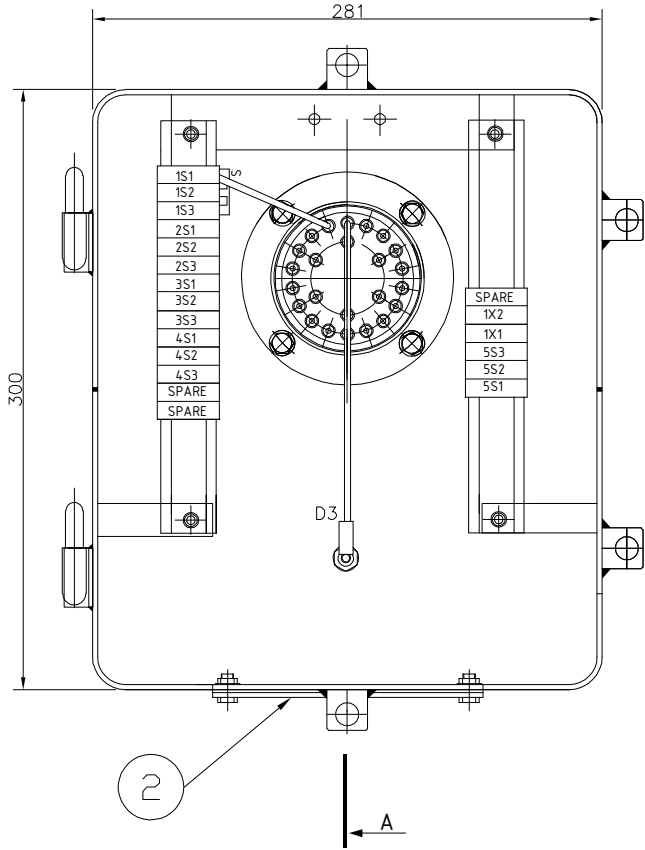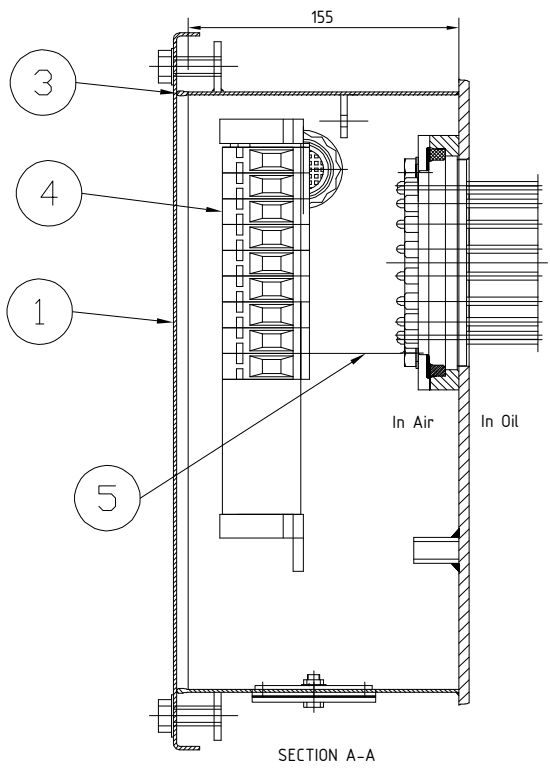

AUX. REACTOR CONNECTION WITH CORE 5 (METERING)



S-Shorting link

D3=Tan δ measuring terminal

Revision Details:
 (A) New Drawing prepared
 (B) Gland plate thickness added BOM created

Revision
 A 2021-01-12
 B 2021-01-29

- NOTES : -
- 1) DEGREE OF PROTECTION IP 55
 - 2) THE SECONDARY TERMINAL BOX IS HOT DIP GALVANIZED
 - 3) D3(TAN DELTA) TERMINAL IS FOR THE MEASUREMENT OF POWER FACTOR AND LOSS ANGLE
 - 4) THE BOX IS SUITABLE FOR ACCOMMODATING SECONDARY CABLES OF 1100 V
 - 5) STEEL SHEET 3.15 mm THICK HOT ROLLED
 - 6) ALL DIMENSIONS ARE IN mm. GENERAL TOLERANCE AS PER ISO: 2768-c
 - 7) NO. OF WIRES SHOWN IN THE TERMINAL BLOCK ARE INDICATIVE ONLY


SR NO.	ITEM DESCRIPTION
5	COPPER WIRE
4	SERIES TERMINAL STUD TYPE
3	EPDM GASKET
2	UNDRILLED GLAND PLATE (3mm Thk.)
1	COVER

Chief Engineer/Construction

We reserve all rights in this document and in the information contained there in the reproduction or disclosure to third parties without express authority is strictly forbidden. @ABB.

TERMINAL BOX	CURRENT TRANSFORMER TYPE : IMB 245 SEC. TERMINAL BOX DETAILS	DRAWN: SR ABB APPSIL	CHECKED: PDS	APPRD.: SN	file: 3320-032	TOTAL SH. 1
					1HYT903320-032	Sh. NO. 1

Item	Core	Current Ratio	Sec. Resistance At 75° C. Ohms	C1	C2
10	1	500/1	-	6.86	0.193
		300/1	-	4.12	0.322
	2	500/1	<5	6.18	0.096
		300/1	<3	5.36	0.096
	3,4	500/1	<5	8.24	0.096
		300/1	<3	6.59	0.096

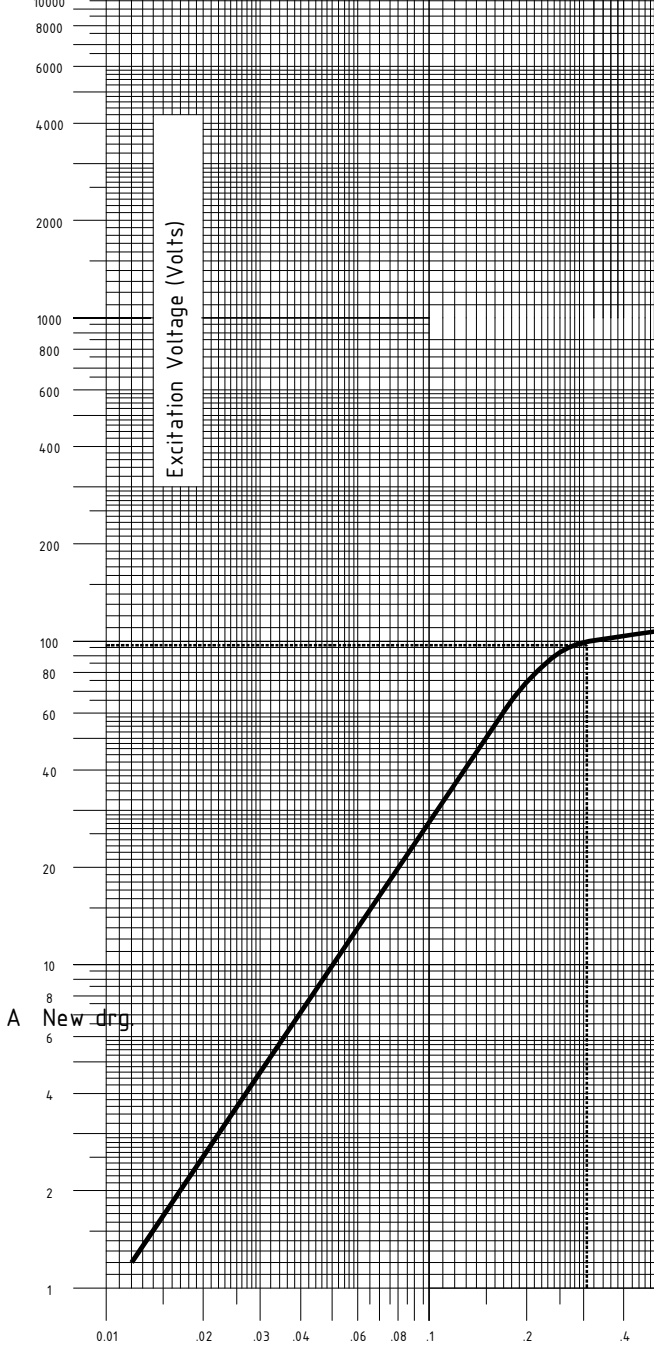

Notes:

1. The exciting current calculated from this graph does not take into account the current drawn by the protective device.
2. The values on the Voltage scale are to be multiplied by C1, while those on the current scale by C2.

Calculated Excitation Curve of Current Transformer

Type: **IMB245**

CORE 1 RATIO: 500-300/1, CLASS OF CLASS: 5P
20VA, 5P20

CORE 2 RATIO: 500-300/1, CLASS OF ACCURACY: PX
Vk >40(Rct+10)/300 V, Rct <5/3 Ohms, Io <30mA at Vk @500/1

CORES 3,4 RATIO: 500-300/1, CLASS OF ACCURACY: PX
Vk >80(Rct+5)/350 V, Rct <5/3 Ohms, Io <30 mA at Vk @500/1

- A New drawing prepared.
- B Sepec. revised

Drawing approval subject to valid vendor registration

Chief Engineer/Construction

NOTE : DRAWING APPROVAL SUBJECT TO VALID TYPE TEST REPORTS, TO BE CHECKED DURING ACCEPTANCE TESTS.

This document is COMPUTER ORIGINAL and does not need signature for its authentication

Drn: SR Chkd: PDS Apprd: SN



filename: 3320-033

1HYT903320-033

NOTE : DRAWING APPROVAL SUBJECT TO VALID TYPE TEST REPORTS, TO BE CHECKED DURING ACCEPTANCE TESTS.

Annexure-A
GUARANTEED TECHNICAL PARTICULARS FOR
CURRENT TRANSFORMERS (245kV CT: 500-300/1-1-1-1 A)

1	Type of tank/Installation Dead/Live Tank Type	Dead tank, Single phase, Oil Filled, Outdoor Type
2	Type of mounting	Pedestal Mounting
3	Manufacturer's Name and address and Country of Manufacture	APPSIL (Formerly - ABB India Ltd) Maneja, Vadodara – 390013 India
4	Whether Conforming to IEC 61869 standard	Yes
5 a) i)	Primary and Secondary winding made out of	Primary – Aluminum, Secondary – Copper
ii)	Primary windings -Design density for short circuit current - Conductivity of metal used -	Aluminum - 44.64 Amp/mm ² (approx.) - As per IEC
b)	i) Area of cross section of primary winding	896 mm ² (approx.)
	ii) Area of cross section of secondary winding	Protection : 0.82 mm ² (approx.) (Core 1) PX : 1.65 mm ² (approx.) (Core 2) PX : 1.59 mm ² (approx.) (Core 3 & 4) Metering : 0.82 mm ² (approx.)
c)	Material used for providing secondary terminals	Brass (Primary Terminal will be Al)
d)	Material used for providing secondary terminals	Brass
e)	Whether Primary is Rigid Bar type in case of live tank	Not applicable
6	Rated primary voltage (kV rms)	220 KV / root3
7	Rated highest voltage (kV rms)	245 KV
8	Rated frequency (Hz)	50 Hz
9	Rated primary current (A)	500-300 A
10	Rated secondary current (A)	1
11	Ratio taps (on secondary side only)	On Secondary Side
12	Type of insulation	Class A
13	Seismic acceleration (g)	0.3 g vertical
14	RIV at 1.1 x Rated voltage (mv)	< 500 micro volts
15	Tank material and Tank coating	Mild Steel, HDG
16	Hardware exposed to atmosphere	HDG
17	Bolts, Nuts and Washers	MS Hot dip galvanized.
18	Porcelain housing and it make (Single piece only)	Hollow type, IEC/BHEL/ABIL/ADI/Modern or Equivalent Make
19	Sealing (Nitrogen gas cushion/Metal bellow)	Nitrogen cushion
20	Instrument security factor	<5 (For Metering core only)
21	Whether Tan Delta test tap provided	Yes
22	Whether secondary terminal plate	Yes

Chief Engineer/Construction

NOTE : DRAWING APPROVAL SUBJECT TO VALID TYPE TEST REPORTS, TO BE CHECKED DURING ACCEPTANCE TESTS.

	is of molded epoxy resin type	
23	Whether primary terminal bushings are of molded Epoxy cast resin/Glass fiber reinforced Polymer	Molded cast resin & Porcelain
24	Whether all seals are of "O" ring type	Yes "O" ring & Flat gasket
25	Whether all "O" Rings are fixed in machined grooves with adequate space for compression'	Yes
26	Whether the main hollow insulator has the flanges cemented at both ends	Yes
27	Whether "O" Rings are of Nitrile butyl rubber or Viton	Yes (NBR)
28	Whether the Short circuit Ampere-turns of the CT being supplied is same as type tested CTs	Yes
29	Tan Delta	Shall be less than 0.350%
30	Whether ratio selection is achieved only in secondary	Yes
31	Whether ratio selection is achieved only in secondary	Yes
32	Whether Non return drain valve for oil sampling is arranged for 132kV and above CT/IVT	Bolt Type
33	Acceptable limit of temperature	As per IS/IEC
34	Partial Discharge Level	< 5 at $U_m \times 1.2/\sqrt{3}$, < 10 at U_m (where U_m is highest system voltage)
35	Rated short time withstand current for 1 sec. duration (kA rms)	40 kA
36	Rated dynamic withstand current (kAp)	100 kA
37	Rated continuous thermal current (pu) where pu = rated current	120% of rated primary current
38	1.2/50 micro second impulse withstand voltage (kVp)	1050
39	One minute power frequency withstand voltage (kV rms) of primary winding (Dry)	460
40	One minute power frequency withstand voltage of secondary winding (kV rms)	3
41. a)	Minimum total creepage distance of insulator bushing (mm)	6125 mm (25mm/kV) Porcelain Insulator
b)	Protected creepage of distance of bushing (mm)	Not Applicable
42	Details of Cores	Core-I Core-II Core-III Core-IV Core-V

Drawing approval subject to valid vendor registration

Chief Engineer/Construction

42.1	Current Ratios A/A	500-300/1	500-300/1	500-300/1	500-300/1	500-300/1
42.2	Output burden (VA)	20	-	-	-	20
42.3	Class of accuracy	5P	PX	PX	PX	0.2S
42.4	Accuracy limit factor / ISF	20	-	-	-	<5
42.5	Min. knee point voltage (kpv) in volts	-	>40 (Rct+10) @500/1	>80 (Rct+5) @500/1	>80 (Rct+5) @500/1	
42.6	Secondary resistance corrected to 75 deg.C in ohms	-	5-3@ Ohms	5-3@ Ohms	5-3@ Ohms	
42.7	Max. Exciting current (mA) at - 20% of knee point voltage - 50% of knee point voltage - 100% of knee point voltage	- - -	- - <30 at Vk @ 500/1	- - <30 at Vk @ 500/1	- - <30 at Vk @ 500/1	
42.8	Application	PX	PX	PX	PX	Metr.
43	Weight of oil (Kg.)	150 Kg (approx.)				
44	Approximate weight of Copper used (Kgs)	15.25 Kg.				
45	Approximate weight of Steel used (Kgs)	200 kg.				
46	Total Weight (Kg.)	1150 kg (approx.)				
47	Mounting details	450x450 (Please refer GA enclosed)				
48	Overall dimensions	Please refer GA drawing enclosed				
49	Characteristics (whether graphs enclosed):					
a)	Ratio and phase angle curves	Yes				
b)	Magnetization curves	Yes				
c)	Ratio correction factor curves	NA				
50	Core					
a)	Area of cross section (sq.cm.)	18 sq. cm. (PX Core - 2) 38.5 sq. cm. (PX Core – 3 & 4)				
b)	Flux density at rated primary current and rated burden	As per Standard design practice				
c)	Grade	M4 (Or equivalent) For PX Core Nano Core For Metering Core				

Drawing approval subject to valid vendor registration

Chief Engineer/Construction

NOTE : DRAWING APPROVAL SUBJECT TO VALID TYPE TEST REPORTS, TO BE CHECKED DURING ACCEPTANCE TESTS.